

Addendum

No. TWO Date: 03.20.2019

Project:

**HVAC IMPROVEMENTS TO
VARIOUS GYMNASIUMS FOR THE
PICKENS COUNTY SCHOOLS
CARROLTON, ALABAMA**

MCKEE PROJECT NO. 18-257

The following modifications/ changes and/or substitutions to the plans and specifications are hereby made a part of same and are incorporated in full force as part of the contract documents.

Bidders shall acknowledge receipt of this Addendum in writing on their Proposal Form.

A2.1 GENERAL MODIFICATIONS:

- A. None

A2.2 SPECIFICATION MODIFICATIONS:

- A. See attached letter from Zgouvas, Eiring & Associates Consulting Engineers, Inc. dated March 20, 2019, herein.


A2.3 DRAWING MODIFICATIONS:

- A. See the attached Revised Drawings as follows:
E0.5 Dated 03.15.19


B2.1 CLARIFICATIONS:

- A. Owner will pay for all utility company connections required.

END OF ADDENDUM TWO

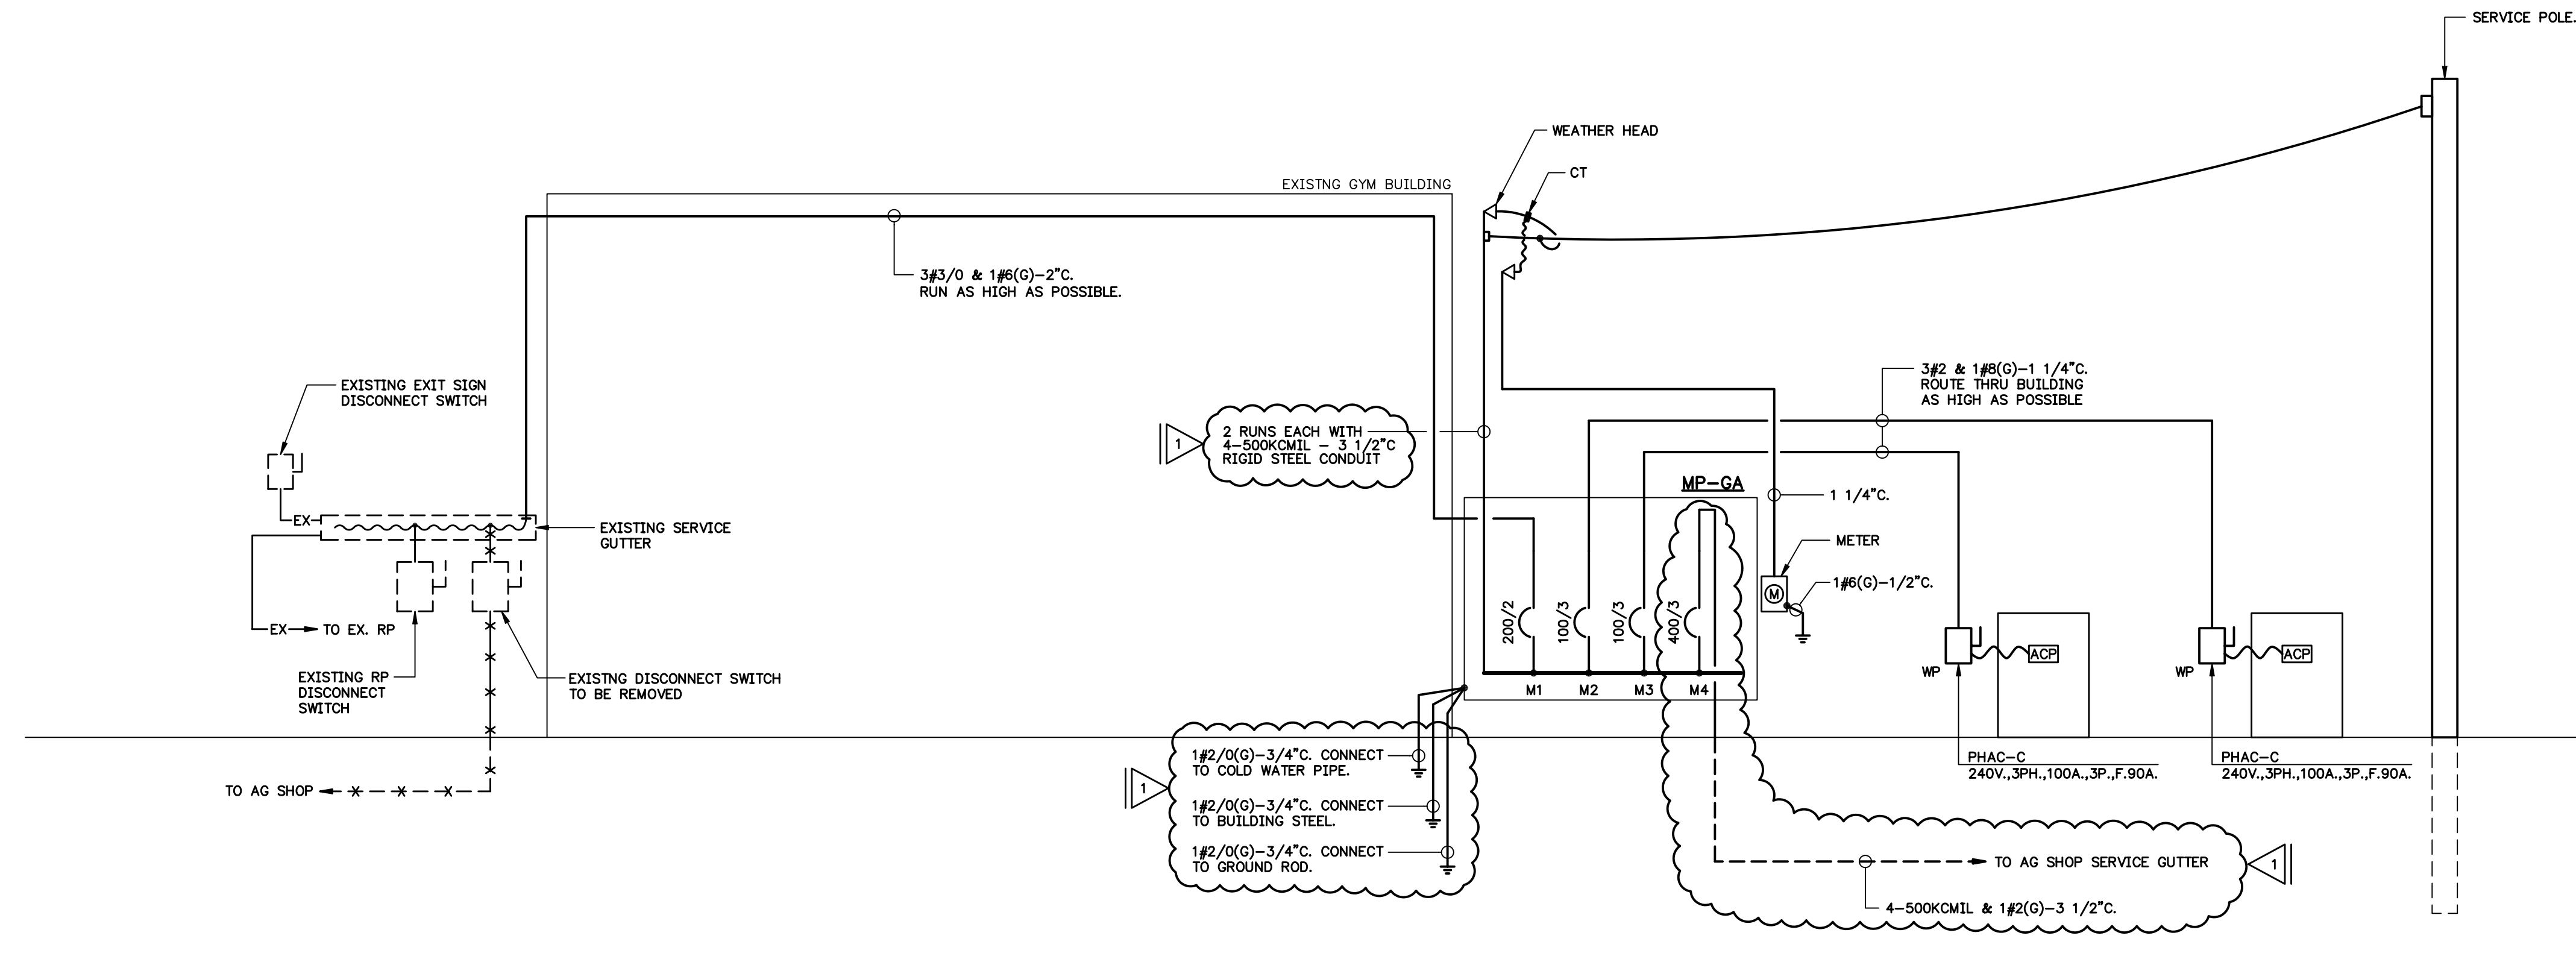

RISER DIAGRAM
 POWER DISTRIBUTION
 GORDO HIGH SCHOOL GYM
 NO SCALE

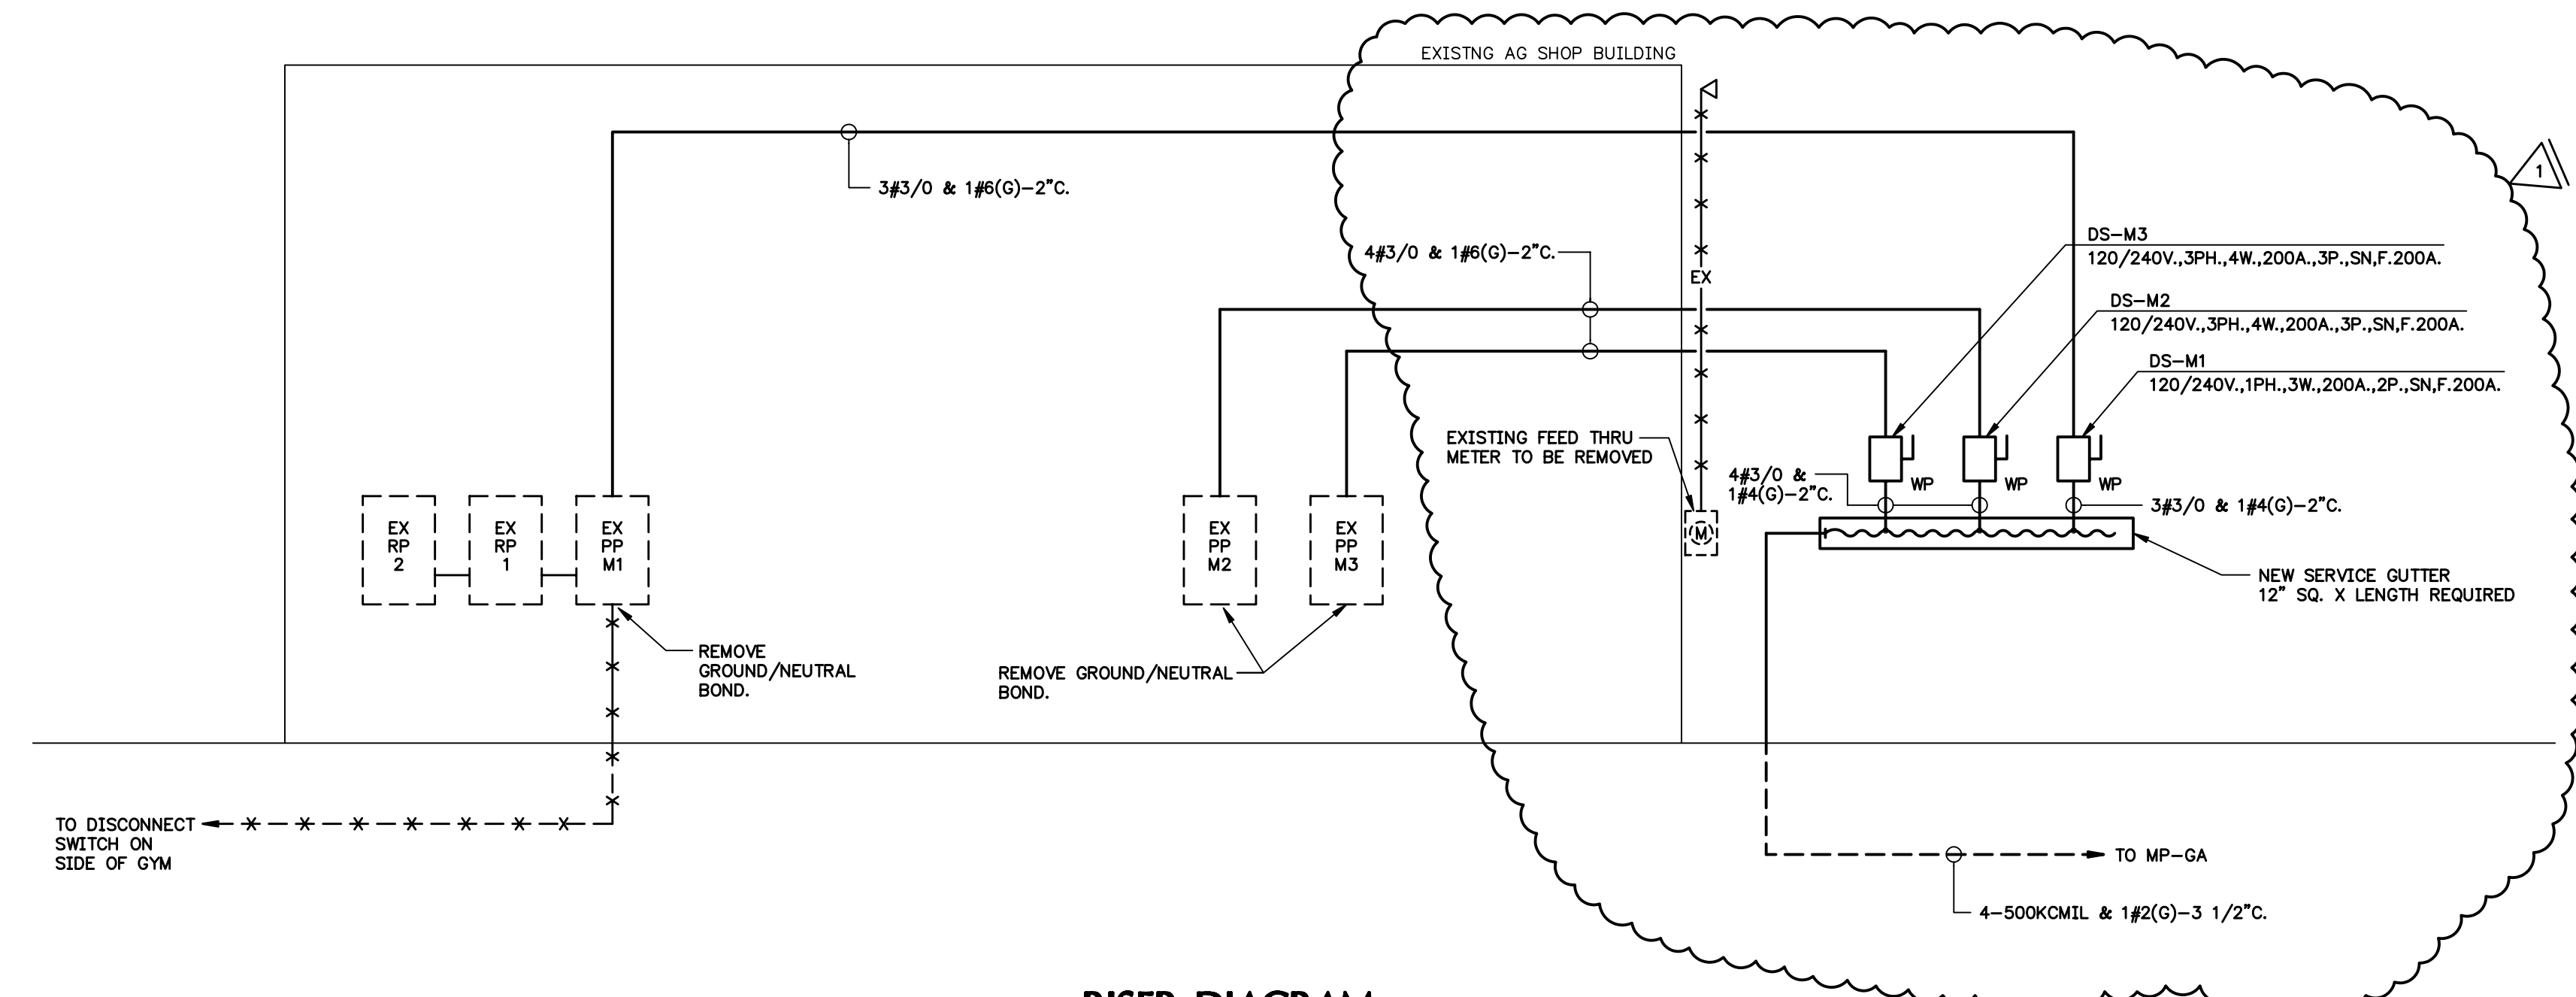

RISER DIAGRAM
 POWER DISTRIBUTION
 GORDO HIGH SCHOOL AG SHOP BUILDING
 NO SCALE

HVAC IMPROVEMENTS
 TO
 VARIOUS GYMNASIUMS
 FOR THE
 PICKENS COUNTY SCHOOLS
 CARROLLTON, ALABAMA

MCKEE and ASSOCIATES
 ARCHITECTURE and INTERIOR DESIGN
 631 SOUTH HULL STREET, MONTGOMERY, ALABAMA 36104 (334) 834-8933

SHEET TITLE :	RISER DIAGRAMS AND SCHEDULE
MCKEE JOB # :	18.257
DRAWN BY :	SDH
DATE :	02.22.19
REVISED DATE :	03-15-19
REVISED DATE :	
REVISED DATE :	

V:\Projects\018-02-18-19-AT-10-19-STE-E
 SCALE: 1/2"=1'-0"
 DATE PLOTTED: MARCH 18, 2019
 PLOTTED BY: STEVE AT 15:23



ZGOUVAS, EIRING & ASSOCIATES
CONSULTING ENGINEERS, INC.

HVAC Addendum Pickens County Schools HVAC Upgrades

March 20, 2019

1. Refer to the Specifications, Section 15700-23, Para. 13.8, Smoke Detectors. Clarification: Smoke detectors shall be furnished and installed by the Mechanical Contractor. Provide as specified and wire to shutdown the unit upon the detection of smoke as specified.

END OF ADDENDUM